

**MONTANA-DAKOTA UTILITIES CO.**  
**ANNUAL ELECTRIC RELIABILITY REPORT-MONTANA**  
**CALENDAR YEAR 2007**  
**MONTANA RULE 38.5.8619**

Reliability Index with Identified Storm Event(s)	Montana			Glendive District			Wolf Point District		
	2007	2006	2005	2007	2006	2005	2007	2006	2005
SAIFI (System Average Interruption Frequency Index)	0.30	0.43	0.50	0.37	0.42	0.66	0.10	0.46	0.06
SAIDI (System Average Interruption Duration Index)	42.10	38.57	56.18	43.00	40.36	65.42	39.70	33.73	30.85
CAIDI (Customer Average Interruption Duration Index)	140.40	89.36	111.95	115.30	96.11	98.53	384.50	72.79	535.64

Reliability Index-Without Identified Storm Event(s)	Montana			Glendive District			Wolf Point District		
	2007 2/	2006	2005 1/	2007 2/	2006	2005 1/	2007 2/	2006	2005 1/
SAIFI (System Average Interruption Frequency Index)	0.30	0.43	0.50	0.37	0.42	0.66	0.10	0.46	0.04
SAIDI (System Average Interruption Duration Index)	35.60	38.57	49.87	42.20	40.36	65.42	17.80	33.73	7.23
CAIDI (Customer Average Interruption Duration Index)	120.10	89.36	100.39	113.90	96.11	98.53	184.80	72.79	187.64

SAIDI and CAIDI reported in minutes

1/ A storm occurring in Brockton, Montana (Wolf Point District) on July 11, 2005 while not classified as a major storm event by definition did affect reliability indices.

2/ The following storm outages while not classified as a major storm event by definition did affect reliability indices.



\* Glendive 5/6/07 8:00 p.m. to 5/7/07 1:00 p.m.

\* Glendive 8/10/07 6:00 a.m. to 9:00 a.m.

\* Wolf Point 6/17/07 11:00 a.m. to 6/18/07 10:30 a.m.

\* Wolf Point 7/3/07 8:00 a.m. to 7/5/07 2:00 p.m.

MONTANA-DAKOTA UTILITIES CO.  
RELIABILITY INDEX WITH IDENTIFIED STORM EVENT(S)

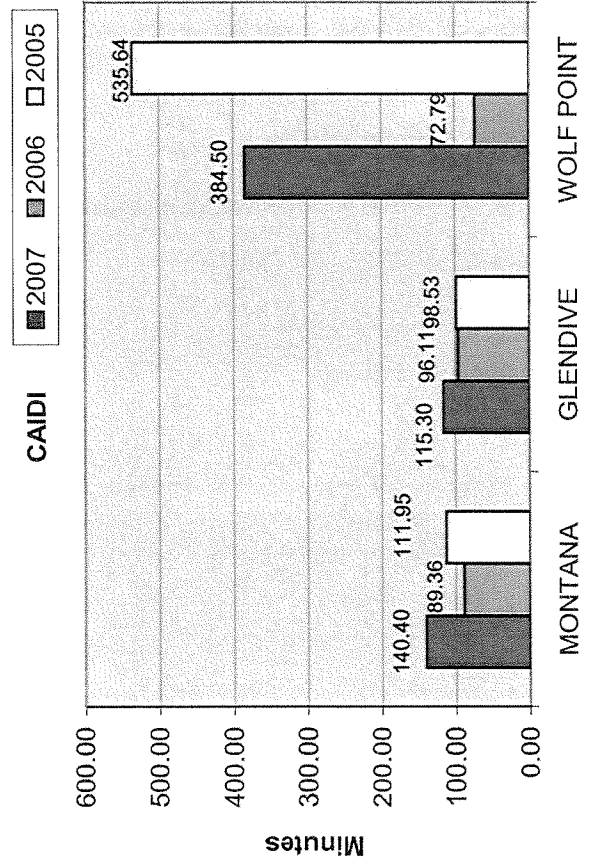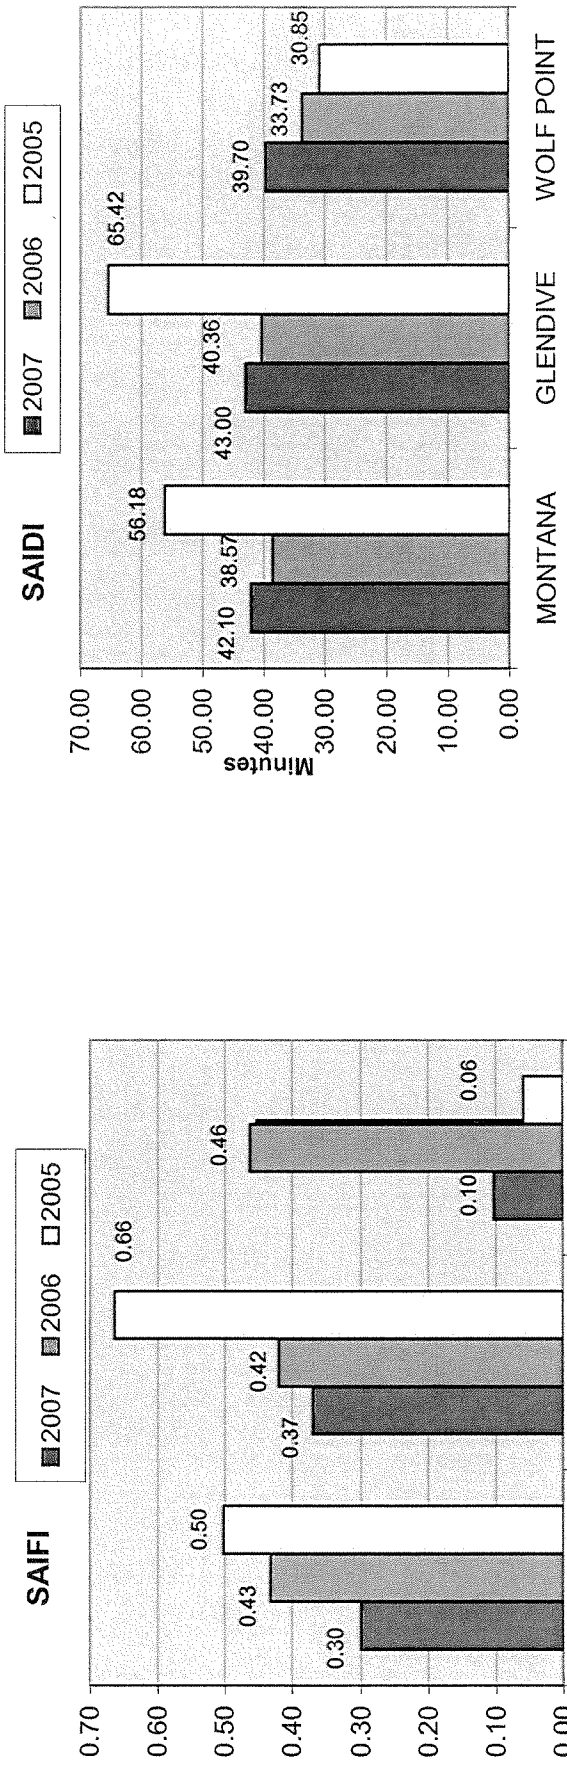

MONTANA-DAKOTA UTILITIES CO.  
RELIABILITY INDEX WITHOUT IDENTIFIED STORM EVENT(S)

